


NOTES:

1. WESTERN UNION CONDUIT IN AREA
PHONE MR. W.C. HENDRIX
CITY PLANT MGR., CA 4-9851
2. TELEPHONE CONDUIT IN AREA
PHONE MISS HAWLEY,
CA 3-9972, FOR LOCATION.
3. ELECTRICAL CONDUIT IN AREA
PHONE MR. BEN SCHOLL
CA 7-3211, FOR LOCATION.
4. CURBS REMOVED IN THE PROCESS OF WATER
MAIN CONSTRUCTION WILL NOT BE REPLACED.
ALL PAVEMENT SHALL BE REPLACED.
5. MAIN CONSTRUCTION WILL CROSS
STREET CAR TRACKS ON DOLOROSA ST.
SEE DETAIL SHEET NO. 2.

CONTRACT NO.	JOB NO. <u>3835</u>	SHEET <u>1</u> OF <u>2</u>			
LOCATION <u>SANTA ROSA & MONTEZ</u>	CITY WATER BOARD SAN ANTONIO, TEXAS				
DEVELOPER <u>CWA</u>	<i>URBAN RENEWAL PROJECT I - PHASE I</i>				
ACTION NUMBERS	CODE <u>E-128</u> BUDGET PROJECT <u>38432</u>				
<u>4</u> MAIN INSTALLATION	DRAWN <u>B. Smith</u> CHECKED <u>J. Hall</u>				
<u>74</u> MAIN REMOVAL OR ABANDONMENT	SUBMITTED <u>L. H. Smith</u> DATE <u>1/10/64</u>				
<u>6</u> FIRE HYDRANT INSTALLATION	APPROVED <u>L. H. Smith</u>				
<u>76</u> FIRE HYDRANT REMOVAL	DATE <u>11-2-64</u>				
SERVICE REPLACEMENT (RELAY)					
<u>77</u> SERVICE REMOVAL OR ABANDONMENT	MAP NO <u>233, 287, 291</u> SECTION NO. <u>25, 31, 32</u>				
NOTE:	REVISONS				
	No.	REVISION	DRAWN	APPROVED	DATE

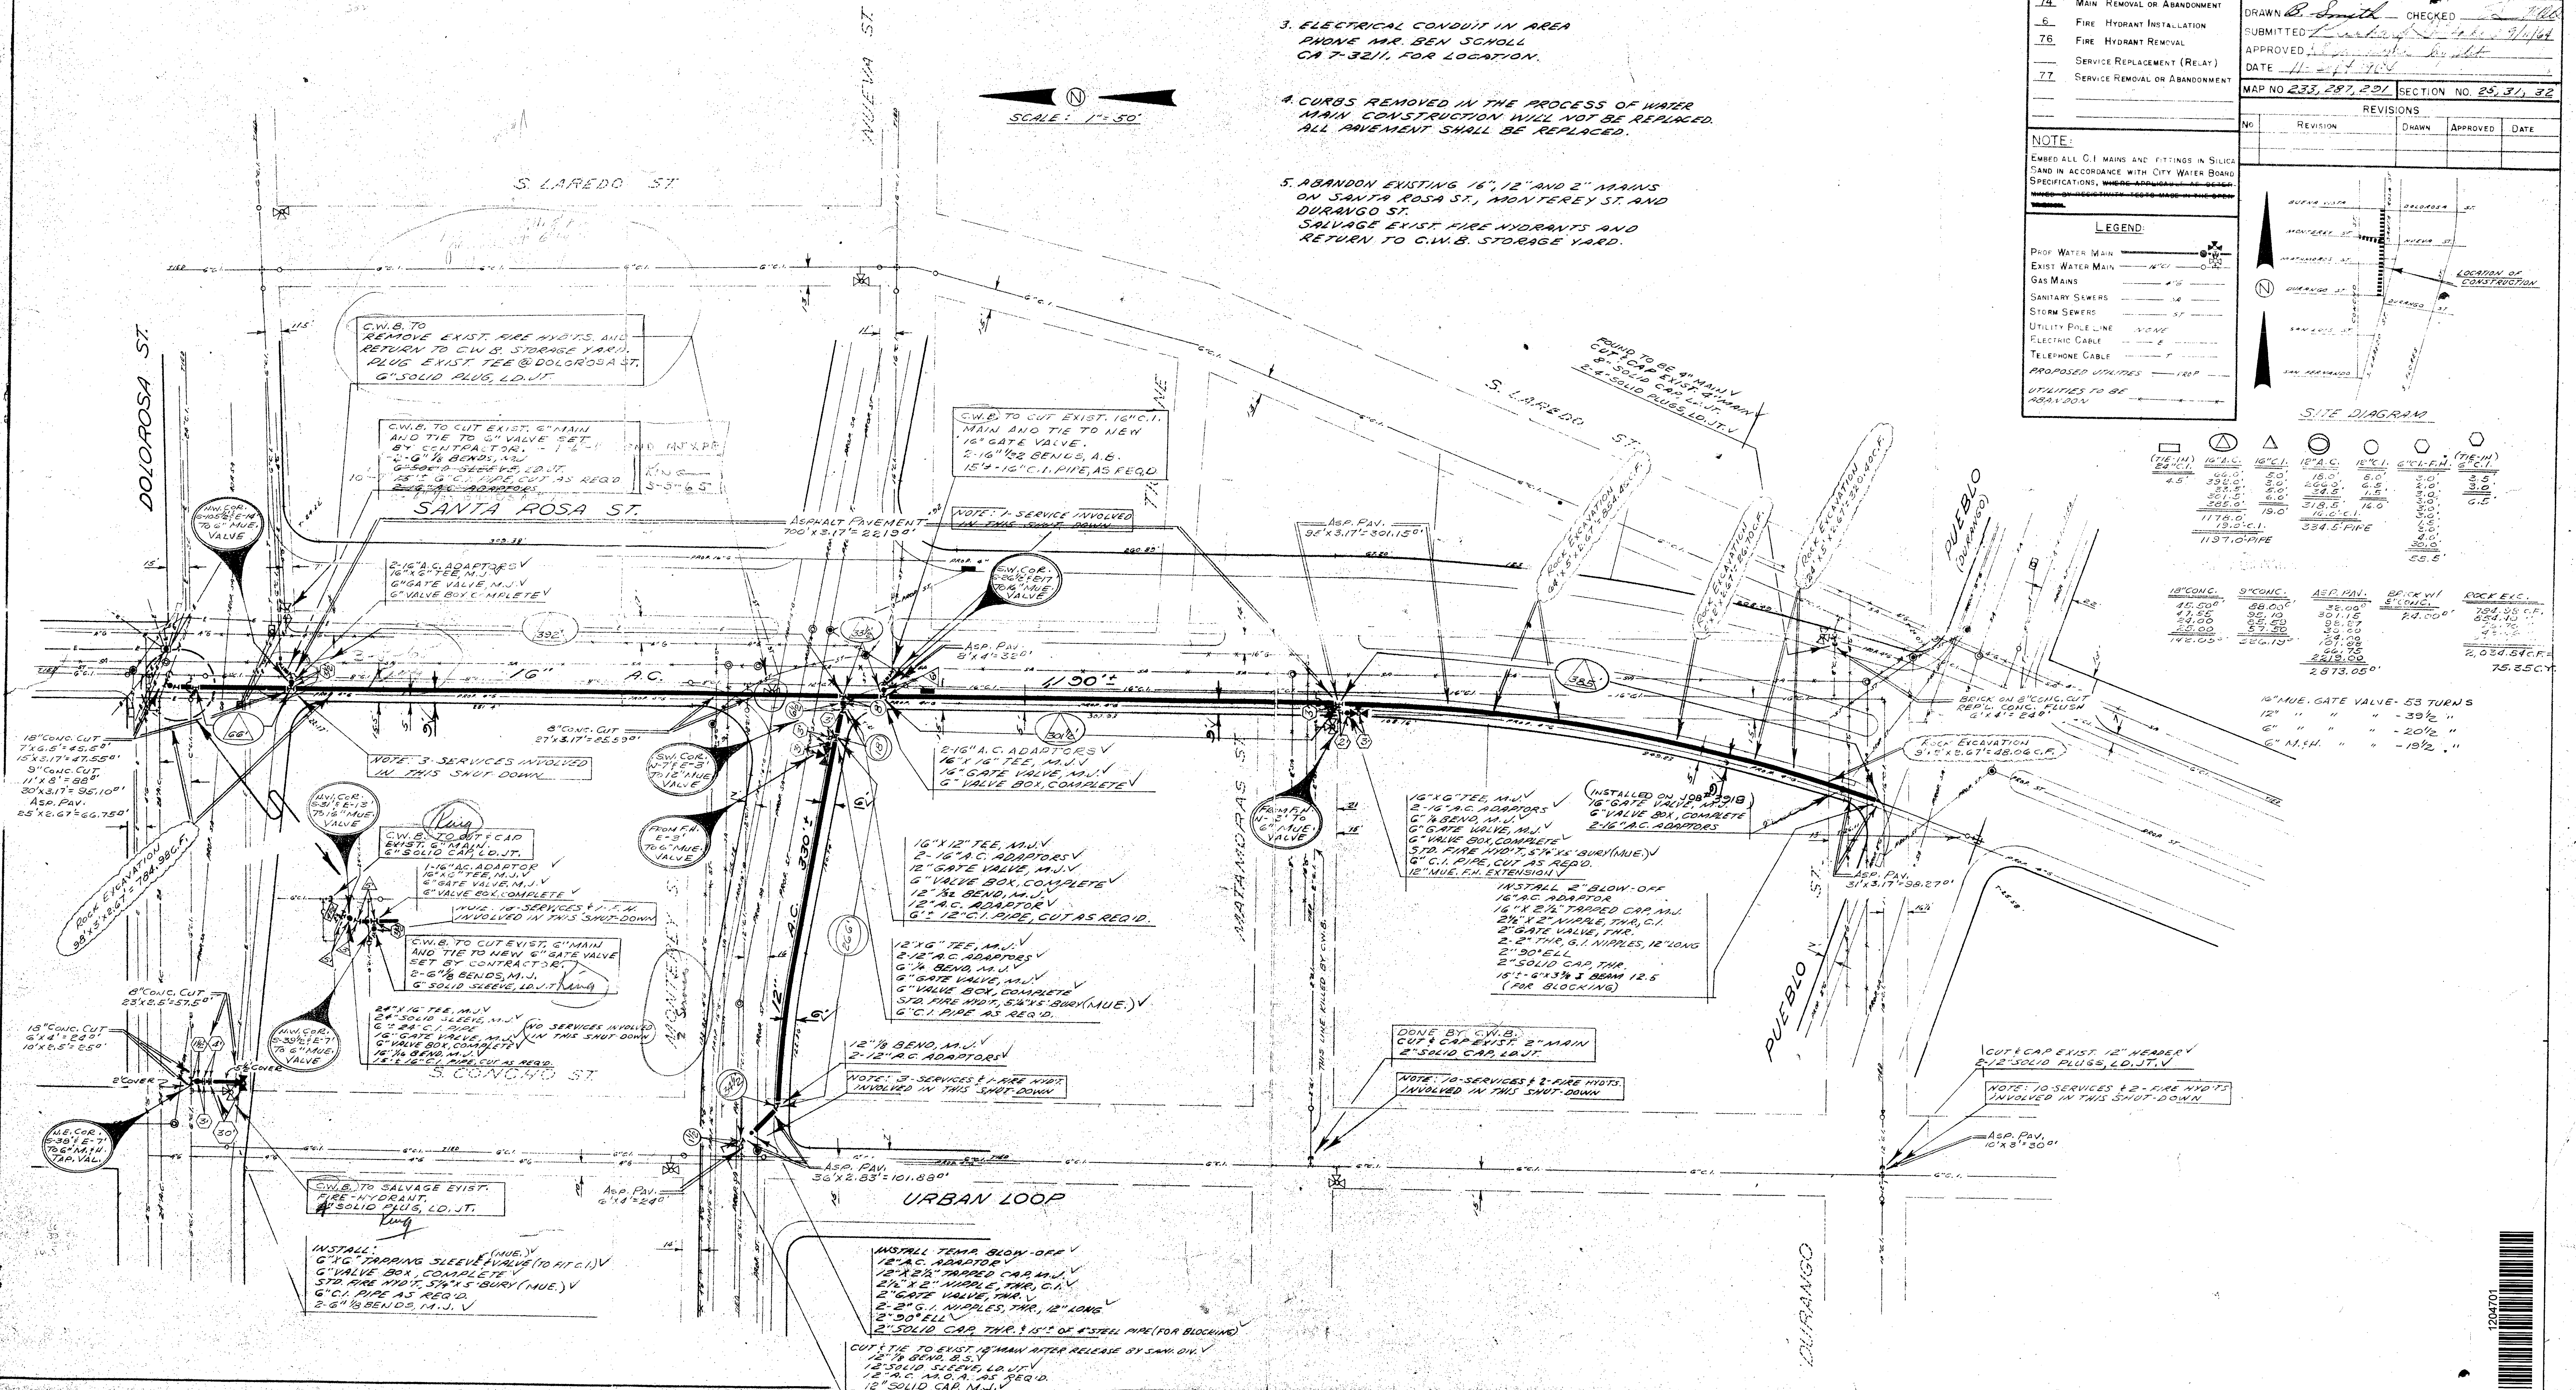

5. ABANDON EXISTING 16", 12" AND 2" MAINS ON SANTA ROSA ST, MONTEREY ST. AND DURANGO ST.
SALVAGE EXIST. FIRE HYDRANTS AND RETURN TO G.W.B. STORAGE YARD.

[illegible]